


# INSTRUCTIONS for LF-35



# NANO

**DOME LAMP FIXTURE**

**READ AND SAVE ALL SAFETY INSTRUCTIONS  
BEFORE OPERATING LAMP FIXTURE**

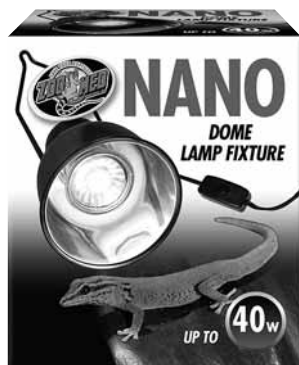

Congratulations on your purchase of **ZOO MED'S NANO DOME® LAMP FIXTURE!** The following instructions will assist you with the proper set-up and operation of this unit. Please read the following instructions carefully. If you have any questions regarding these instructions or the proper use of this product, please contact our customer service department at the phone or email address listed below. Thank you for purchasing a quality Zoo Med product!

**EMAIL:** [zoomed@zoomed.com](mailto:zoomed@zoomed.com)

**WEBSITE:** [www.zoomed.com](http://www.zoomed.com)

or by calling (888) 496-6633 (US and Canada only).

Customers in other countries, please call (805) 542-9988.

## FEATURES:

- Ceramic Socket: Fixture rated for Zoo Med's Nano heating & lighting products up to 40 watts.
- Very small dome fixture for nano-size terrariums (10 gallons maximum).
- Ideal for small geckos, hatchling reptiles, tarantulas, insects and other invertebrates.


## SAFETY INSTRUCTIONS:

**WARNING! RISK OF FIRE:** In order to reduce the risk of fires or electric shock, read and save these instructions prior to operation.

- **DO NOT** exceed electrical rating. 40 watts maximum.
- **DO NOT** splice, repair, or modify. Fully extend cord before using.
- For indoor use only.
- **DO NOT** use in wet conditions. Not for use with aquariums.
- Keep children and pets away from fixture.
- Fully insert plug. Unplug power cord before inserting or changing bulb.
- Unplug when not in use.
- To avoid possible electric shock, **DO NOT** insert objects other than appropriately rated light bulbs into socket.
- **DO NOT** cover with blankets, rugs or any material.
- **DO NOT** operate the unit with a damaged cord, plug, or other component. If the cord is damaged, discard the lamp.
- **DO NOT** alter or modify this product. Contact an electrician if you are unsure about the electrical connection.
- This unit has no user-serviceable parts. Do not attempt to examine or repair this product.
- Make sure this lamp fixture is **SECURELY** suspended above the terrarium. Zoo Med's Reptile Lamp Stand (Item LF-21) is a good choice for suspending this lamp fixture.

## OPERATING INSTRUCTIONS:

Be sure that the lamp is unplugged and that the switch is in the "off" position before installation. Insert the desired Zoo Med Nano heating or lighting product into the fixture. Securely suspend the lamp fixture in the desired safe location above your terrarium. Zoo Med's Reptile Lamp Stand (Item LF-21) is a good choice for suspending this lamp fixture above your terrarium as shown. This lamp fixture can get hot and is designed for use outside of the terrarium. Do not allow children or your terrarium animals to contact heat lamps or this lamp fixture. Read all safety instructions before use.

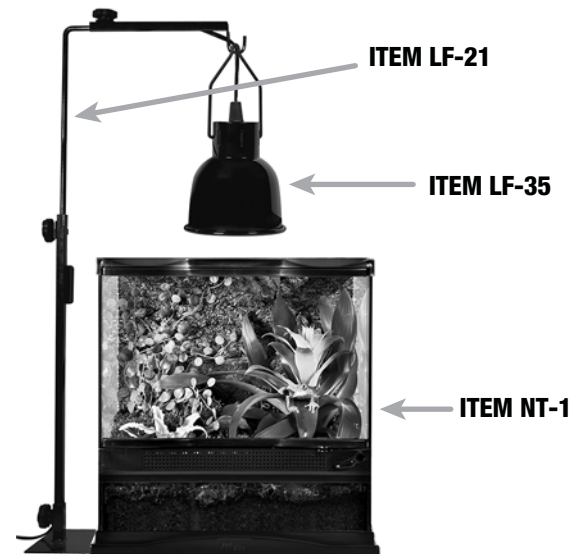

**DESIGNED FOR USE WITH ZOO MED'S  
NANO HEATING & LIGHTING PRODUCTS:**



SL-25N NANO  
BASKING SPOT LAMP



RS-25N NANO  
INFRARED HEAT LAMP



CE-25N NANO  
CERAMIC HEAT EMITTER



ES-5N NANO  
LED



SL-40N NANO  
BASKING SPOT LAMP



RS-40N NANO  
INFRARED HEAT LAMP



CE-40N NANO  
CERAMIC HEAT EMITTER



HB-35N NANO  
HALOGEN HEAT LAMP

## WARRANTY:

Zoo Med Laboratories, Inc. (Zoo Med) warrants this product to be free of defects in material and workmanship under normal use and service for one year from the date of purchase. The obligation under this warranty is limited to the repair or replacement, at Zoo Med's discretion, of the product or any part thereof, when the product is returned to Zoo Med, freight prepaid. No claim shall be allowed under this warranty if, in the opinion of Zoo Med, this product has been subject to accident or improper usage, including but not limited to: water damage, improper storage, accidental dropping, etc. This warranty is in lieu of all other warranties and representations express or implied. Please include your receipt, full name, address, phone number, and email address along with a note explaining failure when sending any product back to Zoo Med. Please allow 4 to 6 weeks for repair or replacement.

**ZOO MED LABORATORIES, INC.**

3650 Sacramento Dr. - San Luis Obispo, CA 93401 - email: [zoomed@zoomed.com](mailto:zoomed@zoomed.com)

**[www.zoomed.com](http://www.zoomed.com)**